


Crow Runner Alarm Panel



- ✓ **Keyswitch wiring**
- ✓ **Keyswitch programming**


Background: There are three (3) Outputs available.

- Outputs are 'Open Collector' @50mA switching negative - for heavier loads a relay must be used.
 - Outputs can be used for e.g. Keyswitch, opening gates or doors etc.
 - Ensure there is a common negative between Permaconn and the device being switched.
 - The outputs can be Opened, Closed or Pulsed remotely using the Permaconn Atlas web portal.
 - The Pocket Secure App can only 'Pulse' the Outputs. A Pulse is approx 1sec.
-  Compatible with 'Pocket Secure' remote arming App, available on iTunes, Google Play and the Windows Phone Store.
- These outputs when wired to a Keyswitch zone on the Alarm Panel can arm & disarm up to a maximum of three (3) areas when using 'Pocket Secure' app.
 - Each area should be independently controlled using a separate Keyswitch zone.
 - Arm/Disarm reporting **MUST be Enabled**. Pocket Secure App requires this for its status notifications.
 - Test each Output by placing the +ve leg of a multi meter on the +ve terminal that supplies power to the Permaconn, then place the -ve leg of a multi meter on the Output terminal you wish to test. Pulse the selected Output the result should go from 0v DC to 12v DC for approx 1sec and back to 0vDC.


Crow Runner Alarm Panel

The Tamper input can also provide two Key-Switch functions.

E.g. 1: The Low key-switch (4k7 resistor in Parallel) is Key-switch 1 or Area 1.

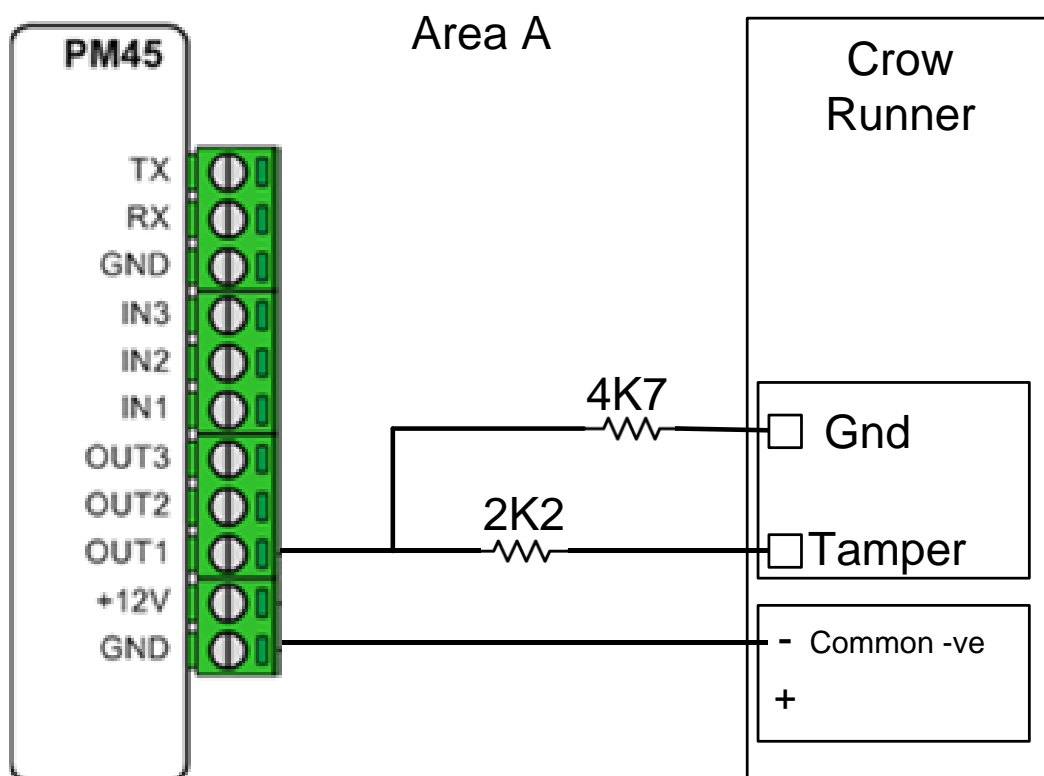

E.g. 2: The High key-switch (8k2 resistor in Parallel) is Key-switch 2 or Area 2.

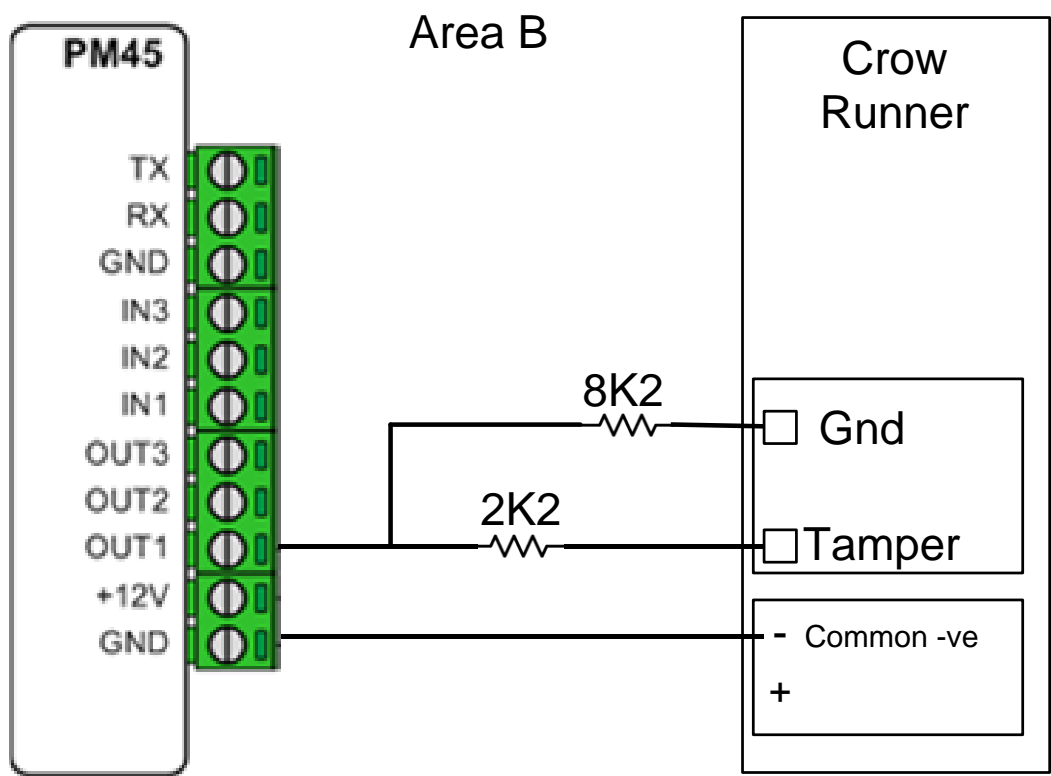


P111E: KEY-SWITCH AREA ASSIGNMENT

1-2E:
K/S 1 & 2 are assigned to Areas A or B
(Default K/S # 1 = 1 and K/S # 2 = 2)


P112E: KEY-SWITCH ACCESS & OPERATIONAL OPTIONS

- 1-2E
- 1: K/S # 1 and 2 = K/S # 2
 - 1: K/S can Arm Area ü
 - 2: K/S can arm Stay Mode
 - 3: K/S can Disarm Area ü
 - 4: K/S can disarm Stay Mode
 - 5: K/S has Security Guard Options
 - 6: K/S will Arm Latchkey Mode
 - 7: Key-switch is N/O (If turned off the K/S is N/C)
 - 8: Key-switch is Momentary (If turned off the K/S is Latched)

2KΩ resistor

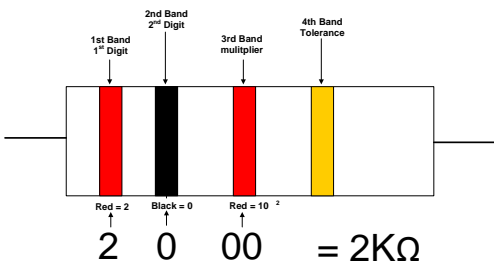

8K2Ω resistor

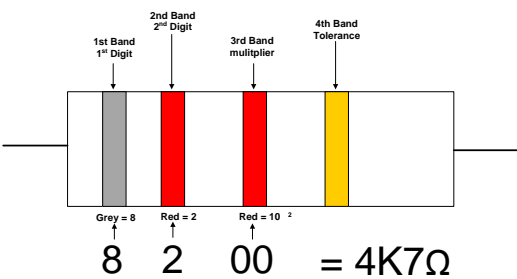

4K7Ω resistor

